


GENERAL NOTES

- COORDINATE EXACT LOCATION OF EACH LIGHTING FIXTURE WITH CABLE TRAY LAYOUTS AND AIR DUCT LAYOUTS.
- FIXTURES SHALL BE LOCATED AT THE SAME ELEVATION IN EACH ROOM, UON.
- FOR LIGHTING PANEL SCHEDULES SEE DWG E9.21.34
- FOR LIGHTING FIXTURE SCHEDULES SEE DWG E9.30.01
- PROVIDE 2" RIGID GALVANIZED STEEL SLEEVES FOR ALL CONCRETE CEILING AND WALL CONDUIT PENETRATIONS. LOCATE WALL PENETRATIONS IN THE BASEMENT 12" BELOW CEILING. SEE DETAILS AS NOTED.
- ALL CONDUITS RUN IN THE CEILING AREA IN THE BASEMENT SHALL BE MINIMUM OF 8'-6" ABOVE THE FINISHED FLOOR.

SHEET KEYNOTES

N001 ALL CONDUITS, CONDUIT FITTINGS AND J-BOXES IN THIS ROOM SHALL BE NON CORROSIVE EPOXY COATED GALVANIZED RIGID STEEL. WIRING DEVICES (SWITCHES, ETC.) SHALL BE ENCLOSED IN EPOXY COATED STEEL OR STAINLESS STEEL ENCLOSURES.

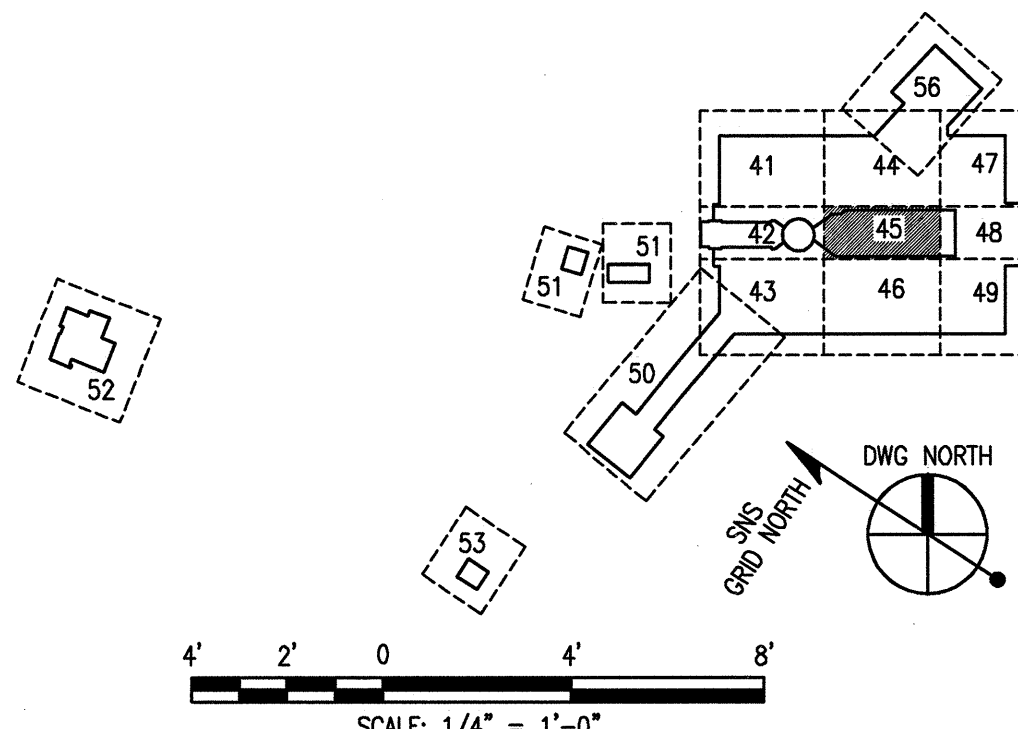

Knight Jacobs
701 S. Main Street
Oak Ridge, TN 37830
865-241-9433
Fax 865-241-3400

UT-BATTELLE
Oak Ridge National Laboratory
managed for the DEPARTMENT OF ENERGY under
U.S. GOVERNMENT CONTRACT DE-AC05-00OR22725
UT-BATTELLE, LLC • Oak Ridge, Tennessee

PROJECT NAME:
SPALLATION NEUTRON SOURCE

**TARGET BUILDING
ELECTRICAL LIGHTING PLAN
LEVEL B1, SECTOR 45**

1	48	49	50	PLANT	BLDG	FL	SH	OF	TYPE	CLASS
3	E	X	X	8	8700		1	1	P	U
51		52	53							
NC		NA	WS		1.8.3.7				E3.B1.45	0

NO REPRESENTATION OR WARRANTY, EXPRESSED OR IMPLIED, IS MADE AS TO THE
ACCURACY, COMPLETION OR USEFULNESS OF THE INFORMATION OR STATEMENTS CONTAINED
IN THESE DRAWINGS, OR THAT THE USE OR DISCLOSURE OF ANY INFORMATION, APPARATUS,
METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS MAY NOT INFRINGE PRIVATE RIGHTS
OF OTHERS. NO LIABILITY IS ASSUMED WITH RESPECT TO THE USE OF, OR FOR DAMAGES
RESULTING FROM THE USE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS
DISCLOSED IN THESE DRAWINGS. DRAWINGS MADE AVAILABLE FOR INFORMATION TO BIDDERS
ARE NOT TO BE USED FOR OTHER PURPOSES AND ARE TO BE RETURNED UPON REQUEST
OF THE FORWARDING CONTRACTOR.

NUMBER OF
SECTION OR
DETAIL

DRAWING ON
WHICH SECTION
OR DETAIL IS
SHOWN OR TAKEN

SECTION AND DETAIL KEY

THIS DOCUMENT
CONTROLLED BY

CHANGE CONTROL
SYSTEM 3

ENGINEERING
PROCEDURE SIS-ENG-0001

REV	DATE	DESCRIPTION	DSN	CHK	DEPT	DATE	PE	DATE	PJ	DATE	REQ	DATE	UTB	DATE	RPE	RPE NO	DATE	ST	CV	EC	EE	EM	IE	M	PD	SE	AR	SQUAD	CHECK
0		CERTIFIED FOR CONSTRUCTION - 10/26/01																											
1	10/26/01	REVISED FOR CONSTRUCTION																											

RPE
DSN H. ORMER 10/26/01
DRW L. MAKOVSKY 10/26/01
CHK V. STEFFEN 10/26/01
DEPT
REQ

DATE 11-13-01
REV 0

DRAWING APPROVALS